

Technical data sheet

Modulating linear actuator for operating air control dampers and slide valves in ventilation and air-conditioning systems

- · For air control dampers up to approx. 1 m²
- Actuating force 150 N
- Nominal voltage AC/DC 24 V
- Control: modulating DC 0 ... 10 V, position feedback DC 2 ... 10 V
- · Lenght of stroke up to max. 60 mm, adjustable in steps of 20 mm
- Adaption of the stroke range

0

Technical data

Electrical data	Nominal voltage	AC 24 V, 50/60 Hz DC 24 V
	Power supply range	AC/DC 19.2 28.8 V
	Power consumption In operation At rest	1.5 W @ nominal force 0.5 W
	For wire sizing	3 VA
	Connection	Cable 1 m, 3 x 0.75 mm ²
Functional data	Actuating force	150 N @ nominal voltage
	Control Control signal Y Operating range	DC 0 10 V, typical input impedance 100 k Ω DC 2 10 V \simeq 0 60 mm
	Position feedback (Measuring voltage U) DC 2 10 V, max. 1 mA
	Position accuracy	±5%
	Stroke	60 mm, fixed
	Direction of stroke at $Y = 0 V$	Reversible with switch 1
	Running time	90 s / 60 mm
	Sound power level	<35 dB (A)
Safety	Protection class	III Safety extra-low voltage
	Degree of protection	IP54 in any mounting position
	EMC	CE according to 89/336/EEC
	Mode of operation	Type 1 (to EN 60730-1)
	Rated impulse voltage Supply	0.8 kV (to EN 60730-1)
	Control	0.8 kV (to EN 60730-1)
	Control pollution degree	3 (nach EN 60730-1)
	Ambient temperature range	–30 +50 °C
	Non-operating temperature	–40 +80°C
	Ambient humidity range	95% r.H., non-condensating (to EN 60730-1)
	Maintenance	Maintenance-free
Dimensions / Weight	Dimensions	See «Dimensions» on page 3
	Weight	460 g

Modulating linear actuator AC/DC 24 V, 150 N with adaption of the stroke range




Safety notes		
	 The actuator is not allowed to be used outside the specified field of not in aircraft or any other form of air transport. Assembly must be carried out by trained personnel. Any legal reguissued by authorities must be observed during assembly. The device may only be opened at the manufacturer's site. It does that can be replaced or repaired by the user. The rotary supports and coupling pieces available as accessories lateral forces are likely. In addition, the actuator must not be tightly bolted to the application movable via the rotary support (refer to «Assembly notes»). If the linear actuator is exposed to severely contaminated atmosph precautions must be taken on the system side. Excessive deposits prevent the gear rack from being extended and retracted correctly. If not installed horizontally, the gear disengagement pushbutton m there is no pressure on the gear rod When calculating the required actuating force, the specifications so or slide valve manufacturers (cross section, design, installation sin conditions must be observed. If a rotary support and/or coupling piece is used, losses in the actuative expected. The device contains electrical and electronic components and is n of as household refuse. All locally valid regulations and requirement 	ulations or regulations not contain any parts must always be used if on. It must remain here, appropriate s of dust, soot etc. can hay only be actuated when supplied by the damper te), and the air flow uation force are to be not allowed to be disposed
Product features		
Mode of operation	The actuator is controlled by means of a standard control signal DC 0 10 V. It opens to the position dictated by this signal. The measuring voltage U allows the damper position (0 100%) to be electrically indicated and serves as a follow-up control signal for other actuators.	
Manual override	Manual operation is possible with the pushbutton (the gearing latch remains disengaged as long as the pushbutton is pressed or detented).	
High functional reliability	The actuator is overload-proof, requires no limit switches and automatically stops when the end stop is reached.	
Adaption of the stroke range	If the manual override pushbutton is pressed once, the actuator travels the set stroke. This stroke can be limited by internal or external mechanical stops.	
Accessories		
	Description	Data sheet
Electrical accessories	Positioner, types SGA24, SGF24 und SGE24	T2 - SG24
	Range controller, type SBG24	T2 - SBG24
	Digital position indication, type ZAD24	T2 - ZAD24
Mechanical accessories	Rotary support to compensate lateral forces, type Z-DS1	T2 - Z-LHA

Coupling piece, type Z-KS2

Mechanical limiter set, type Z-AS2

Electrical installation

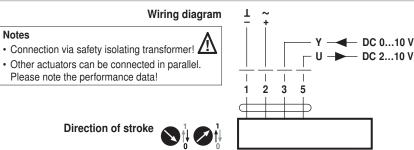

2/3

T2-LH24A-SX60 • en • v1.0 • 11.2006 • Subject to changes

DC 2...10 V


www.belimo.com

T2 - Z-LH..A.. T2 - Z-LH..A..



Dimensions [mm]



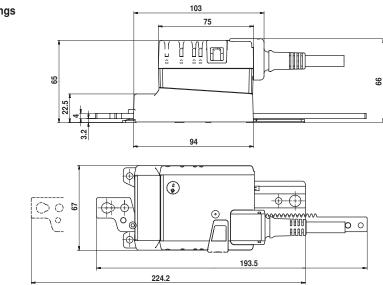

Assembly notes

Application without lateral forces

Application with lateral forces

Caution

If a rotary support and/or coupling piece is used, losses in the actuation force are to be expected.




The linear actuator is screwed directly to the housing at three points. Afterwards, the head of the gear rod is fastened to the moving part of the ventilation application (e.g. damper or slide valve).

The coupling piece with the internal thread (Z-KS2) is connected to the head of the gear rod. The rotary support (Z-DS1) is screwed to the ventilation application. Afterwards, the linear actuator is screwed to the previously mounted rotary support with the enclosed screw. Afterwards, the coupling piece, which is mounted to the head of the gear rod, is attached to the moving part of the ventilation application (e.g. damper or slide valve).

The transverse forces can be compensated for to a certain limit with the rotary support and/or coupling piece. The maximum permissible swivel angle of the rotary support and coupling piece is 10°, laterally and upwards.




LH..A. / LH24A-SX.. / LH24A-MF.. / LH24A-MP.. / LHV-D2-MP...

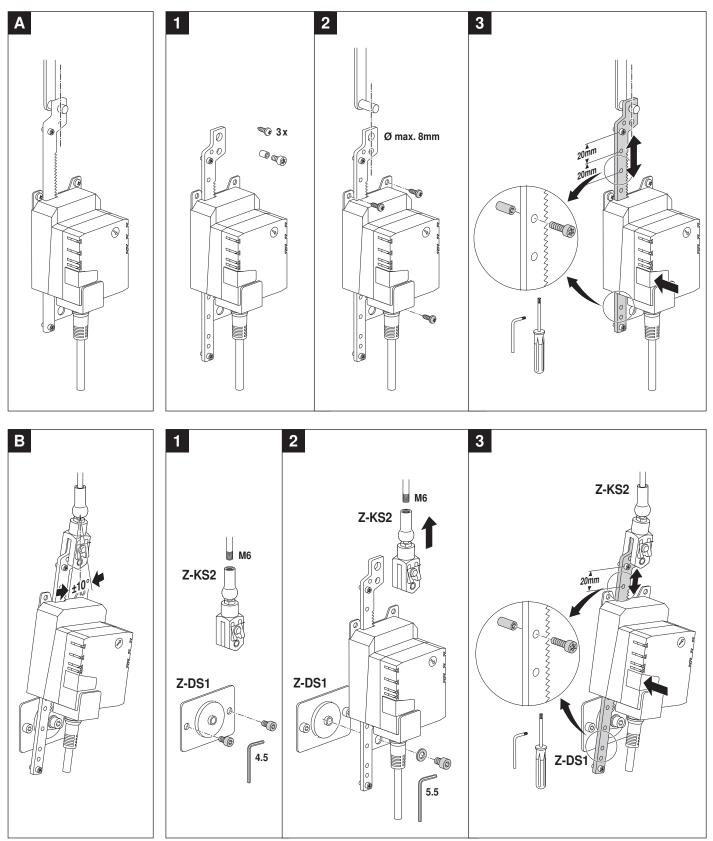




LH24A-SR. / LH230ASR..

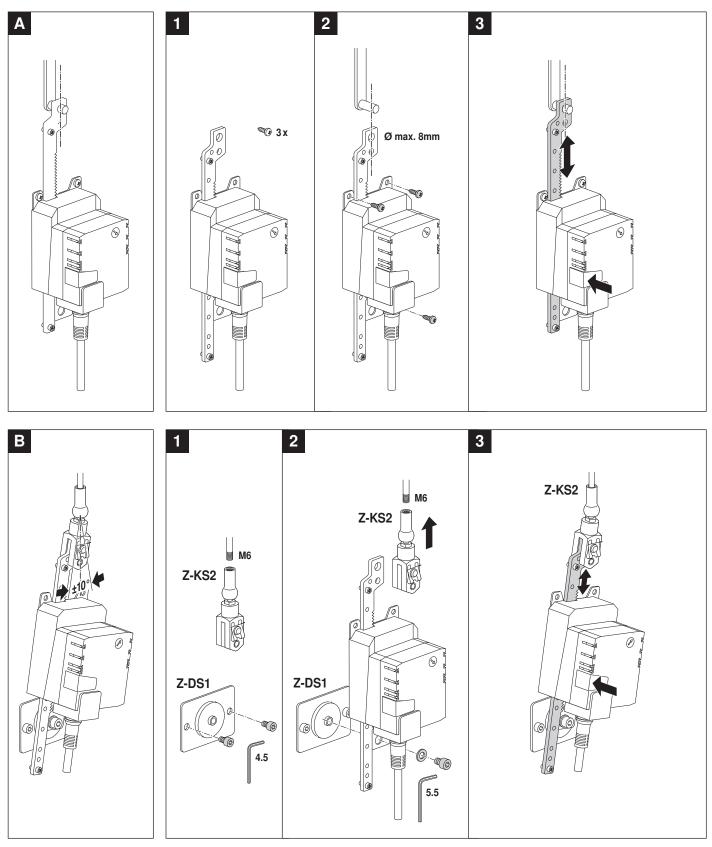




LH..A.. / LH24A-SR. / LH24A-SX.. / LH24A-MF.. / LH24A-MP.. / LHV-D2-MP.. / LH230ASR..

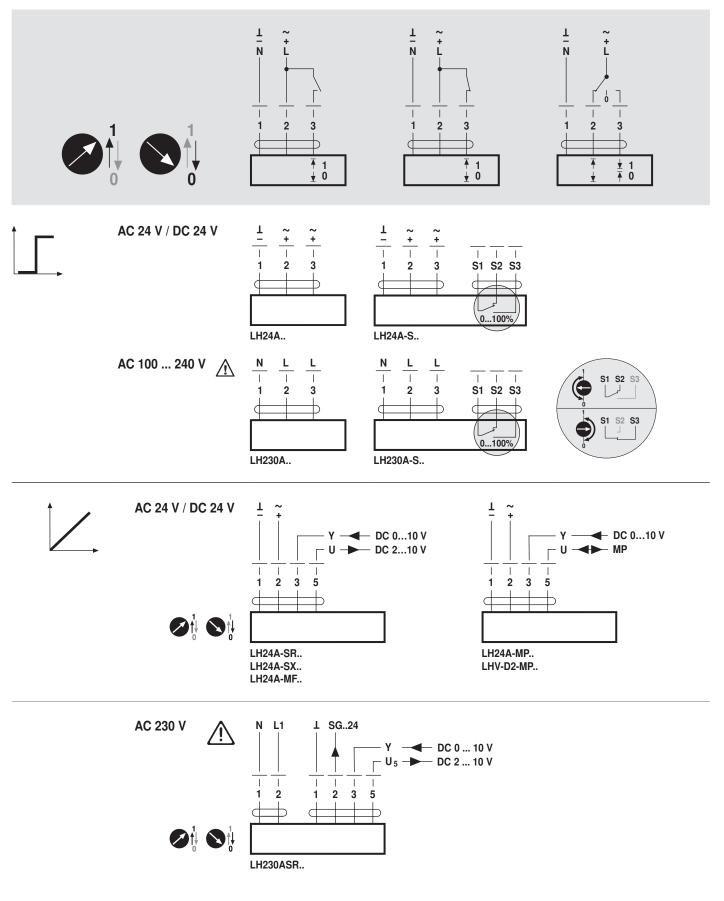


LH..A..



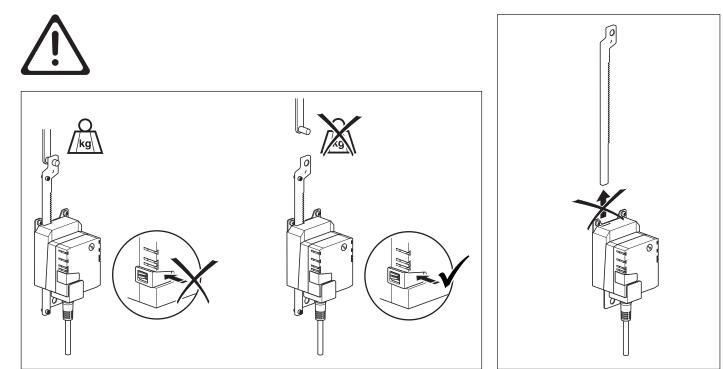

LH..A..TP

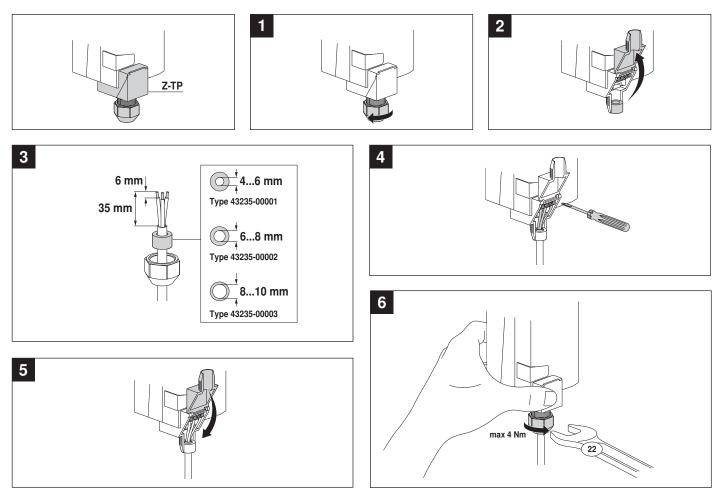

M2-LH..A.. • v1.2 • 07.2009

4/4