

**EO-C..1**

<p>These units are used for lighting control and designed to be installed into ceiling tiles. They can be connected to control circuits or BMS systems. The EO-CL1 has an in-built adjustable lux sensor which will switch on the lighting only when ambient light falls below the pre-set level and movement is detected. The time delay prevents nuisance switching and is reset whenever movement is detected.</p>	 <p>EO-C..1</p>	<p>Terminals 0.5-2.5mm Enclosure Flammability = UL94-V0</p> <p>Lights switch on when movement is detected.</p> <p><b>EO-CL1</b> In-built adjustable lux sensor Set Lux to max. if it is not required. Range: 10-2000 LUX.</p>
---	---	---


Type	Ceiling Mounting	Supply Voltage	Switch Rating 230VAC ±10%	Movement Time Delay	Enclosure
<b>EO-CO1</b>	Flush	12-24VAC/DC	6A Incandescent 6A Fluorescent	10s - 30 mins	IP40
<b>EO-CL1</b>	Flush	12-24VAC/DC	6A Incandescent 6A Fluorescent	10s - 30 mins <b>+ lux sensor</b>	IP40
<b>EE-BP12</b>	Surface Mounting Back Box				

**INSTALLATION:**

Install the unit at least 1m away from any lighting source. Do not mount onto a vibrating surface.


**DO NOT MOUNT IN DIRECT SUNLIGHT OR NEAR HEAT SOURCES.** In larger areas wire more switches in parallel to power the load.

**Flush Mounting:** The occupancy detectors may be flush mounted through a 64mm diameter hole in the ceiling. Use the plastic mounting bracket and clips supplied to fix the flush mounted detector.

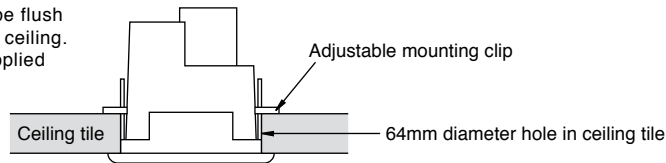


**Surface Mounting:** Alternatively the detectors can be surface mounted using the optional Back Box, which may be screwed to the ceiling.


**DIMENSIONS:**

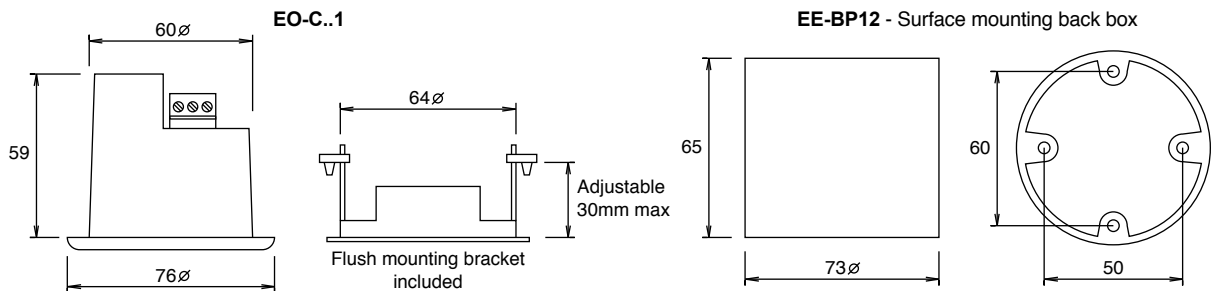

**DETECTION FIELD:**

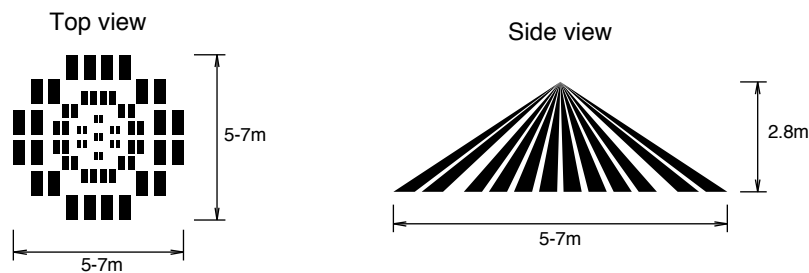

**WIRING:**

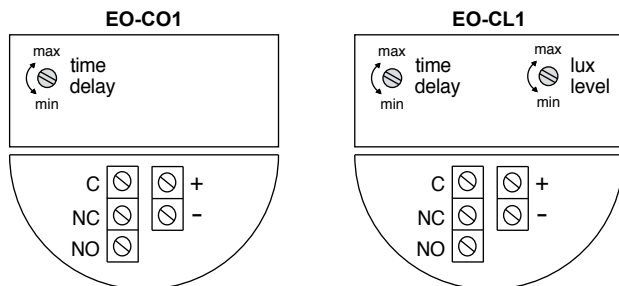

**Time Delay Setting (EO-CO & EO-CL):**

Timing is adjustable between 10secs to 30mins using the screwdriver slot labelled TIME.

**LUX Setting (EO-CL only):**

The LUX level can be adjusted using the screwdriver slot labelled LUX. Turning towards maximum allows the lights to come on at a higher ambient light level (set fully to maximum, lights will be activated regardless of ambient level).

On movement C-NO closes  
No movement C-NO opens (after time delay)