




Thermostatic mixing valve VADO-PRO-100P

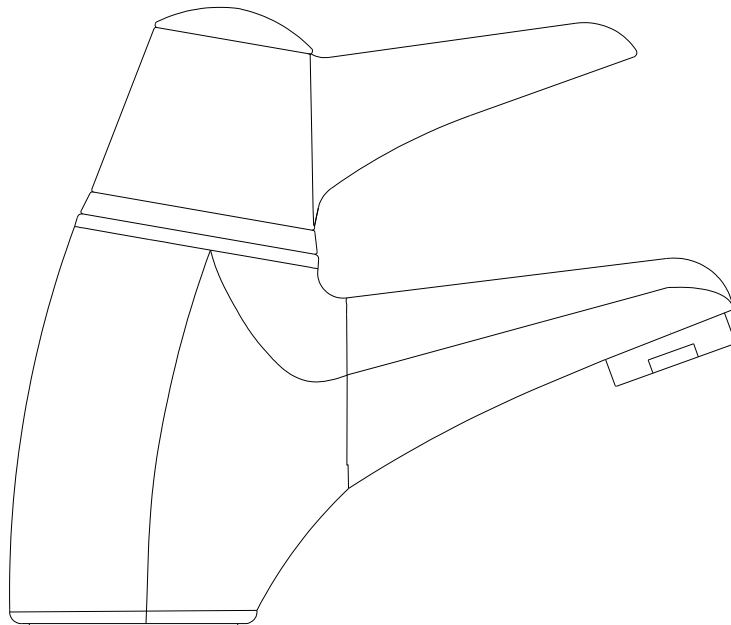

IMPORTANT

Installer: This Manual is the property of the customer and must be retained with the product for maintenance and operational purposes

INTRODUCTION

Thermostatic mixing valves (VADO-PRO-100P) are specified to meet the N. H. S Estate Model Engineering Specifications-D08 of safety, comfort and economy as demanded by today's users. All products are designed, manufactured and supported in accordance with accredited BS EN ISO 9001:2000 Quality Systems.

The following abbreviated designation codes are used throughout this booklet. Detailed descriptions are given below:

HP High pressure
LP Low pressure
W Washer basin

VADO-PRO-100P FOR USE IN THE FOLLOWING DESIGNATIONS

| CODE | OPERATING PRESSURE | APPLICATION |
|------|--------------------|-------------|
| HP-W | HIGH PRESSURE | WASH BASIN |
| LP-W | LOW PRESSURE | WASH BASIN |

DESCRIPTION

The VADO-PRO-100P is a lever operated sequential mixing valve for basins. It uses proven thermostatic technology for temperature control. A single lever provides sequential operation from OFF through COLD and WARM to a maximum blend temperature preset at 41 °C, which can be adjusted if required.

The VADO-PRO-100P is designed for single or two hole basins.

The supply connections are via flexible inlet tails and check valve assemblies that incorporate check valves and filter.

SAFETY: WARNINGS

The VADO-PRO-100P is precision-engineered and should give continued superior and safe performance, provided:

1. They are installed, commissioned, operated and maintained in accordance with the recommendations given in this Manual.
2. Periodic attention is given, as necessary, to maintain the product in good functional order.

The function of a thermostatic mixing valve is to deliver water consistently at a safe temperature. In keeping with every other mechanism, it cannot be considered as being functionally infallible and as such, cannot totally replace the vigilance of

nursing/supervisory staff where that is necessary. Provided it is installed, commissioned, operated and maintained within these recommendations, the risk of failure, if not eliminated, is reduced to minimum achievable.

SPECIFICATION

Important Points:

1. The installation, commissioning and maintenance of this product must be carried out in accordance with instructions given in this Manual, and must be conducted by designated, qualified and competent personnel.
2. Installation must comply with all local/National Water Supply Authority Regulations/Bye-laws, and Building and Plumbing Regulations.
3. Our products are precision-engineered and should give continued superior and safe performance, provided:
 - they are installed, commissioned, operated and maintained in accordance with these recommendations, and
 - periodic attention is given as necessary to maintain the product in good functional order.
4. **Warning:** continued use of this product in conditions outside the limits listed in this section can severely affect the performance and reduce the effective service life, and can present potential risk to users.

Table 1: Conditions for normal use


| Operating pressure range | High pressure | Low pressure |
|---------------------------------|---------------|--------------|
| Maximum static pressure-bar | 10 | 10 |
| Flow pressure, hot and cold-bar | 1 to 5 | 0.2 to 1 |
| Hot supply temperature-°C | 52-65 | 52-65 |
| Cold supply temperature-°C | 5 to 20 | 5 to 20 |

NOTE: Valves operating outside these conditions cannot be guaranteed by the Scheme to operate as Type 3 valves.

Connections:

Inlet supply connections are via the 1/2" BSP internal threads in the checkvalve assemblies, connected to the ends of flexible inlet tails. The reversible insert washers allow for connection to either flat-faced 1/2" BSP external or 15 mm compression unions, The hot supply connection is through the flexible inlet tail nearest the outlet of the Thermostatic mixing valve, identified with a red mark.

Dimensions:

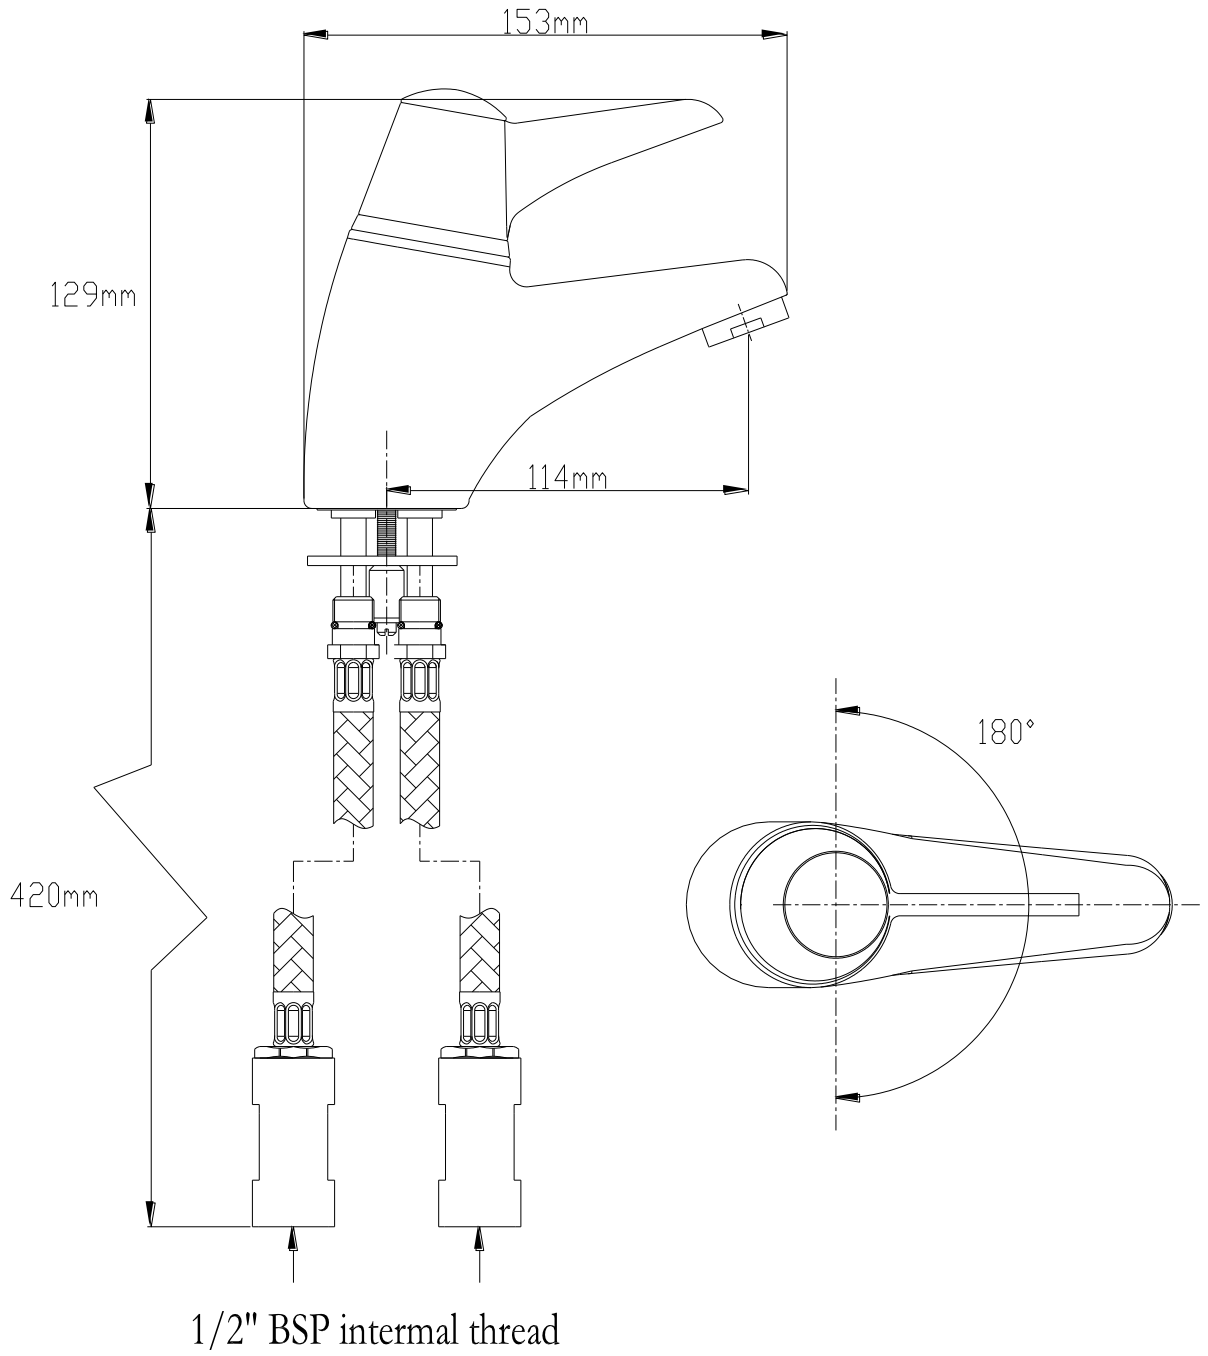

INSTALLATION

General

Installation must be carried out in accordance with these instructions, and must be conducted by designated, qualified and competent personnel.

1. Before commencing, ensure that the installation conditions comply with the information given in the specification section.
2. Care must be taken during installation to prevent any risk of damage.
3. The hole in the basin must be a minimum of 29 mm up to a maximum of 40 mm diameter, with a basin thickness of 30 mm maximum.
4. The Thermostatic mixing valve should be positioned for easy access during use and maintenance. All routine maintenance procedures can be conducted with the Thermostatic mixing valve body in place.
5. Conveniently situated isolating valves must be provided for maintenance.
6. Pipework dead-legs should be kept to a minimum.
7. Supply pipework layout should be arranged to minimize the effect of hydraulic restriction or other outlet usage upon the dynamic pressures at the Thermostatic mixing valve inlets. Recommended minimum supply line pipe diameter is 1/2" or 15 mm.
8. Inlet threaded joint connections should be made with PTFE tape or liquid sealant. Do not use oil-based, non-setting jointing compounds.
9. To eliminate pipe debris it is essential that supply pipes are thoroughly flushed through before connection to the Thermostatic mixing valve.

Procedure (Refer to Figure 1)

1. Screw the fixing studs fully into the Thermostatic mixing valve body.
2. Place the 'O' seal in the groove in the basin of the Thermostatic mixing valve body and place the Thermostatic mixing valve into the hole in the basin.
3. Place the flexible inlet tails through the larger holes in the backplate.
4. Screw the flexible inlet tails into the Thermostatic mixing valve from under the basin and tighten.
5. Pull the backplate over the fixing studs.
6. Make sure that the Thermostatic mixing valve is in the correct position and screw the fixing nuts onto the fixing studs. Tighten the fixing nuts.
7. Select the correct orientation of the insert washers. This is dependant on the type of unions used to terminate the supply pipework.


-For flat-faced unions remove the 'O' seals and place the insert washers into the checkvalve assemblies small end first.

-For 15 mm compression unions place the insert washers, complete with 'O'

seals, into the checkvalve assemblies large end first.

8. Connect the checkvalve assemblies complete with insert washers to the supply pipework. Use a suitable 22 mm spanner/adjustable to tighten the checkvalve assemblies.
9. Locate the fibre washers inside the nuts on the flexible inlet tails and screw the flexible inlet tails on to the checkvalve assemblies. The flexible inlet tail nearest the outlet of the Thermostatic mixing valve must be connected to the hot supply. Use a suitable 24 mm spanner/adjustable to tighten the flexible inlet tails.

Restore the water supplies and check all connections are watertight. Refer to commissioning.

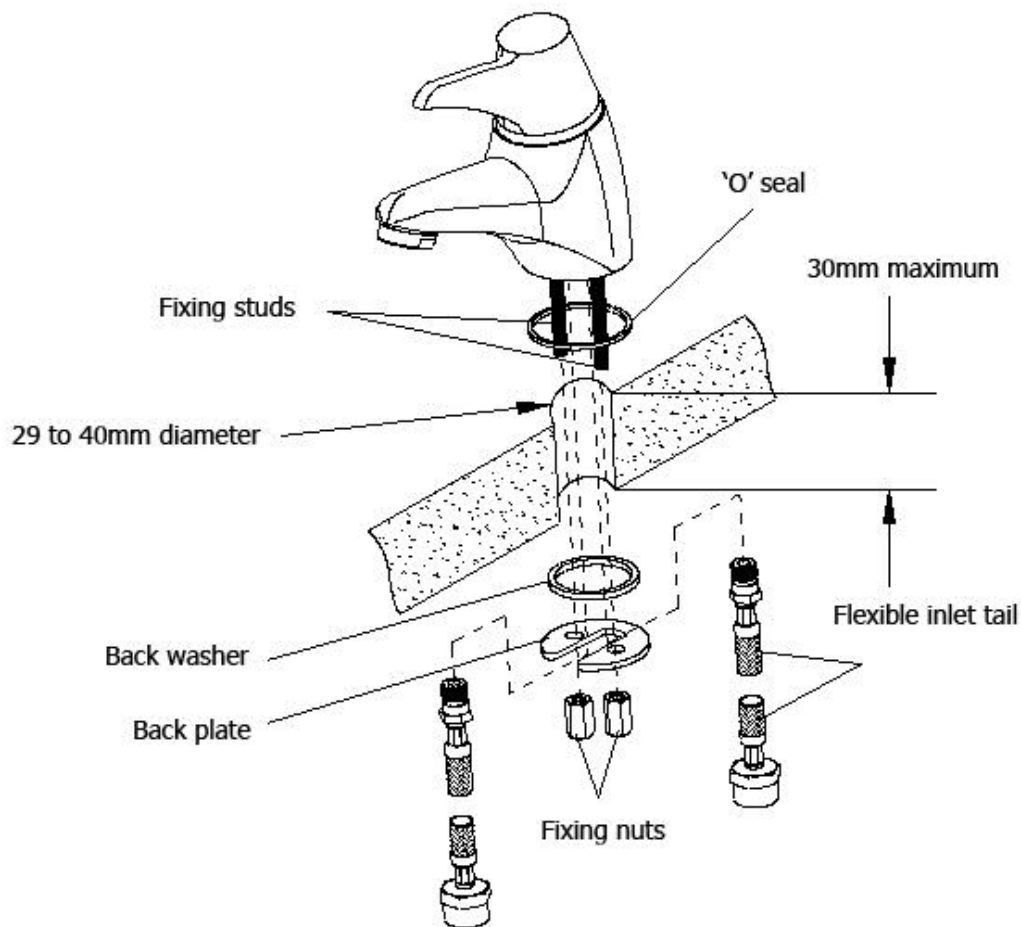

COMMISSIONING

Commissioning must be carried out in accordance with these instructions, and must be conducted by designated, qualified and competent personnel.

Maximum Temperature

The maximum blend temperature obtainable by the user should be limited, to prevent accidental selection of a temperature that is too hot.

The VADO-PRO-100P is fully performance tested, and the maximum temperature is preset to 41°C under ideal installation conditions at the factory. Site conditions and personal preference may dictate that the maximum temperature has to be reset following installation.

Adjust the mixed water temperature in accordance with table 2, the method of adjustment is covered in this COMMISSIONING section.

Table 2: Mixed Water Temperature

| Application | Abbreviated Designation | Mixed water temperature °C |
|------------------|-------------------------|----------------------------|
| Washbasin | -HP-W, -LP-W, | 41 max |

Maximum Temperature Setting:

Make sure that an adequate supply of hot water is available at the hot inlet of the Thermostatic mixing valve.

The minimum temperature of the hot water must be at least 10°C above the desired blend, however during resetting this should be close to the typical storage maximum to offset the possibility of any blend shift due to fluctuating supply temperatures.

Make sure that both inlet isolating valve are fully open.

Temperatures should always be measured using a thermometer with proven accuracy.

1. Use the 2 mm Allen key (supplied) to loosen the grub screw in the lever.
2. Move the lever to full hot, note its position and remove the lever.
3. Let the water run until the temperature stabilizes.
4. Insert the 2 mm Allen key into the grub screw in the centre of the head assembly.
5. Rotate the grub screw as necessary until the required maximum blend temperature is achieved. Rotate the grub screw anticlockwise to increase the temperature or clockwise to decrease the temperature.
6. Refit the lever in its original position. If required the lever can be fitted in any position that allows unobstructed movement of the lever over its operating range.
7. Move the lever to the off position.
8. Use the 2 mm Allen key to tighten the grub screw.

Commissioning Checks


(Temperatures should always be recorded using a thermometer with proven accuracy)

1. Check the inlet pipework temperature for correct function of checkvalves.
2. Operate the Thermostatic mixing valve and check:
 - Flow rate is sufficient for purpose
 - Temperature obtainable is acceptable
 - All connections are watertight.
3. It is advisable to establish a performance check at this time, which should be noted for future reference as part of a Planned Maintenance Program.
The procedure should be chosen to imitate both typical and difficult operating conditions, such as any supply pressure fluctuations that may be likely. An ideal method is to locate another outlet on the common cold water supply close to the fluctuations (operating this outlet should cause a drop in supply pressure), and note the subsequent effect on blend temperature. This should be no more than 2°C change).

Note! Causing thermal shutdown of the Thermostatic mixing valve by full closure of the cold supply may not adequately indicate the practical capability of the Thermostatic mixing valve, nor its service condition. Consequently this is not a recommended performance check, and repeated such testing may ultimately affect service life.

OPERATION

The VADO-PRO-100P has a single lever that provides sequential operation from OFF through COLD and WARM to a preset maximum blend temperature. The maximum temperature is preset to 41°C under ideal installation conditions at the factory. To change this setting, refer to the information given the **commissioning** section.

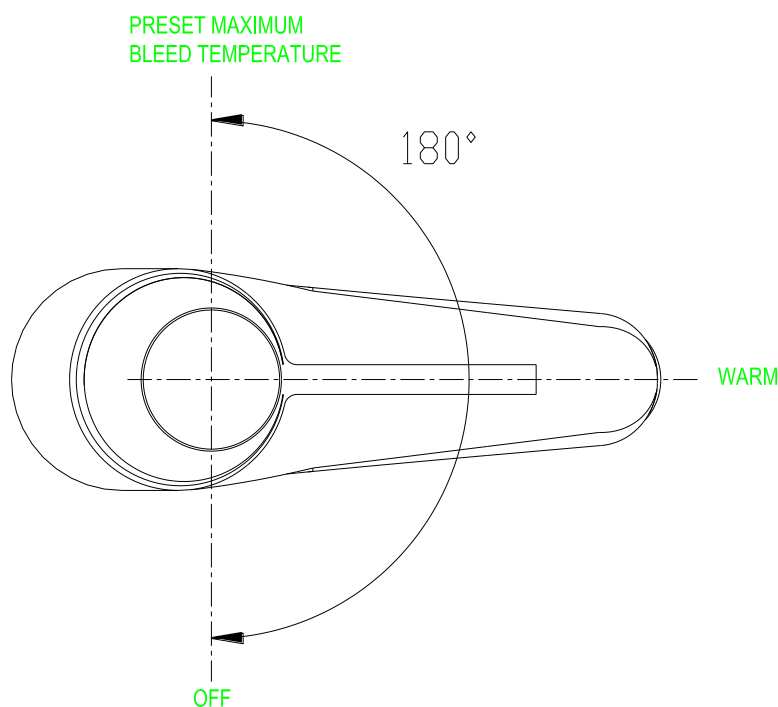

Principle of Operation

IN-SERVICE TESTING

The purpose of in-service testing is to regularly monitor the thermal performance of thermostatic mixing valve. Deterioration in performance can indicate the need for service work to be carried out on the system.

If the authority concerned does not have a planned test and maintenance schedule then the suggestions below should form the basis of a new system.

At intervals of 6-8 weeks and 12-15 weeks after commissioning:-

1. Check supply parameters are still within the expected values if not check system for faults.
2. Carry out commissioning procedures using the same test equipment, if the mixed water temperature has changed a significant amount (by more than 1K) check to ensure in line filters are clean, that the check valves are working and all isolation valves are fully open. If no fault can be found check and record the mixed water temperatures and readjust mixed water temperature to the values in table 2. Complete the commissioning procedure if the mixed water temperature exceeds the values of the maximum recorded temperature by more than 2K the need for service work is indicated.

Depending on the results of these two tests the following should be adopted

- a) If a small change (e.g. 1K to 2K) occurs in one of these tests or there is no significant change (e.g. 1K maximum) then the next in service test should be 24 to 28 weeks after commissioning.
- b) If small changes occur in both test or a larger change occurs in one test (exceeding 2K) then the next in service test should be carried out 18 to 21 weeks after commissioning.

These results can then be used to set a service interval which tests have shown can be used with no more than a small change in mixed water temperature. This method of determining service intervals is used to take into account various in service conditions (i.e. water condition) that the valve may experience.